

September 2006

No.OC321
REVISED EDITION-B

TECHNICAL & SERVICE MANUAL

Series SEZ Ceiling Concealed R410A

Indoor unit
[Model names]

SEZ-KA35VA

SEZ-KA50VA

SEZ-KA60VA

SEZ-KA71VA

[Service Ref.]

SEZ-KA35VA.TH
SEZ-KA50VA.TH
SEZ-KA60VA.TH
SEZ-KA71VA.TH


Revision:

- RoHS PARTS LIST is added in REVISED EDITION-B.
- Some descriptions have been modified.


•Please void OC321
REVISED EDITION-A.

Note:

- This manual describes only service data of the indoor units. When servicing outdoor units, please refer to the service manual No.OC322, OC323 together with this manual.
- RoHS compliant products have <G> mark on the spec name plate.
- For servicing of RoHS compliant products, refer to the RoHS Parts List.

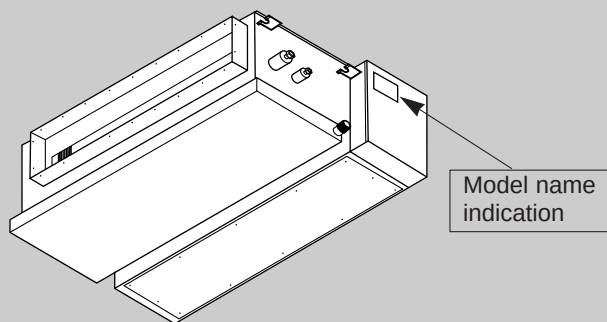

INDOOR UNIT




WIRED REMOTE
CONTROLLER


CONTENTS

1. PART NAMES AND FUNCTIONS	2
2. SPECIFICATIONS	4
3. OUTLINES AND DIMENSIONS	9
4. WIRING DIAGRAM	10
5. REFRIGERANT SYSTEM DIAGRAM	11
6. TROUBLESHOOTING	12
7. DISASSEMBLY PROCEDURE	22
8. PARTS LIST	25
9. RoHS PARTS LIST	27
10. OPTIONAL PARTS	29


Mr.SLIM™

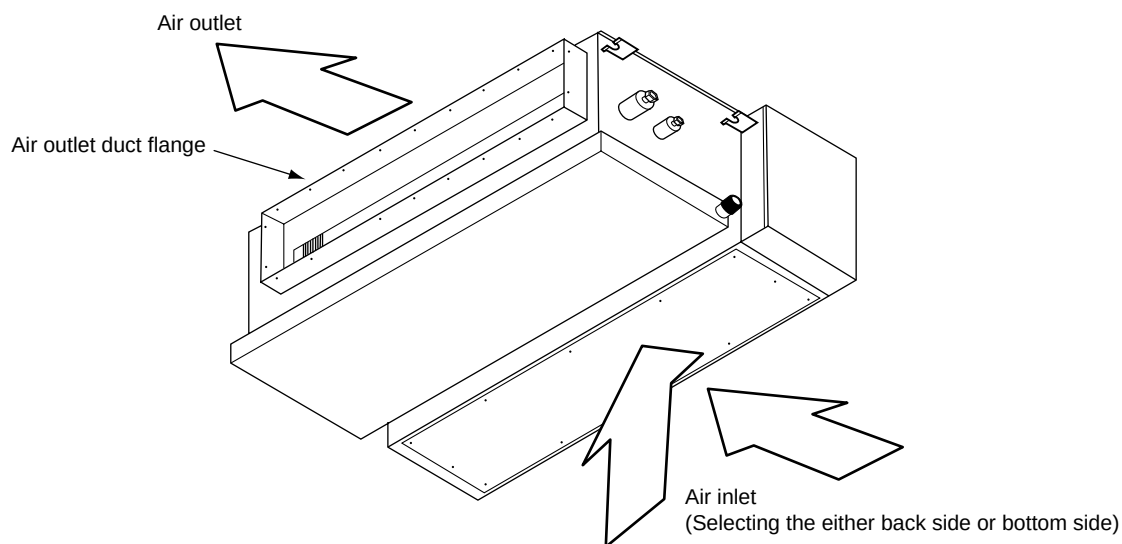Indoor Unit**SEZ-KA35VA.TH****SEZ-KA50VA.TH****SEZ-KA60VA.TH****SEZ-KA71VA.TH****Wired remote controller**

Once the controls are set, the same operation mode can be repeated by simply pressing the ON/OFF button.

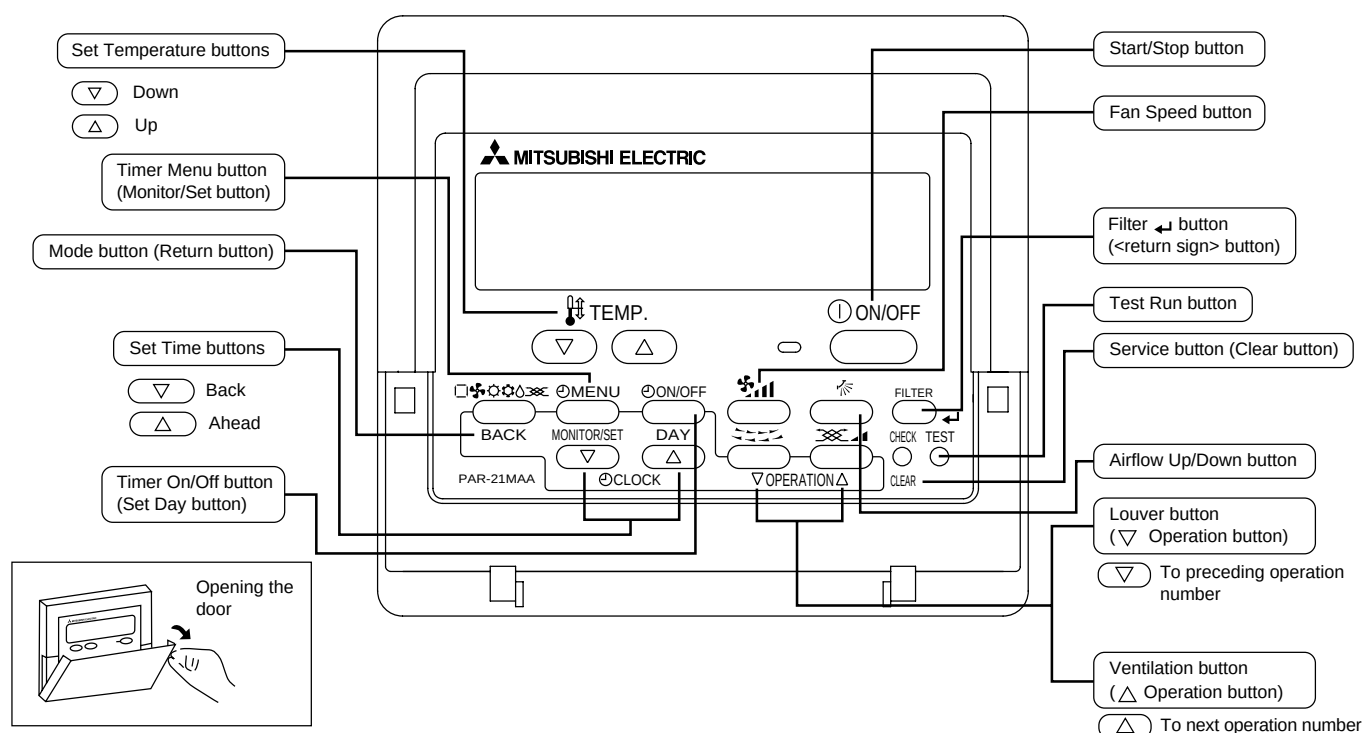● Operation buttons

● Display

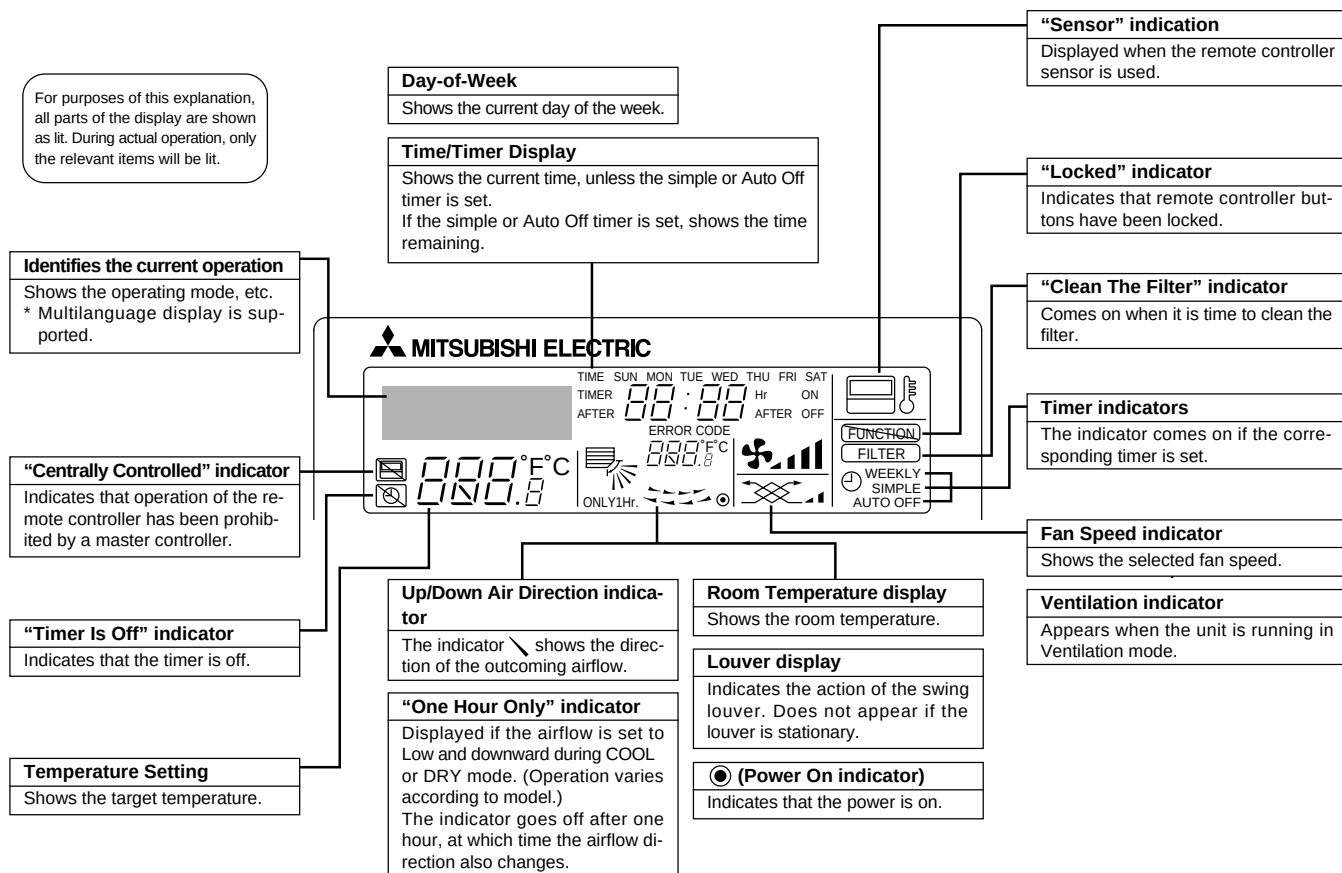

Caution

- Only the Power on indicator lights when the unit is stopped and power supplied to the unit.
- If you press a button for a feature that is not installed in the indoor unit, the remote controller will display the "Not Available" message.
If you are using the remote controller to operate multiple indoor units, this message will appear only if the feature is not present at the parent unit.
- When power is turned ON for the first time, it is normal that "PLEASE WAIT" is displayed on the room temperature indication (For max. 2minutes). Please wait until this "PLEASE WAIT" indication disappears then start the operation.

Indoor model			SEZ-KA35VA.TH		SEZ-KA50VA.TH	
Function			Cooling	Heating	Cooling	Heating
Power supply			Single phase 230V, 50Hz		Single phase 230V, 50Hz	
Capacity	Air flow (High/Low)	m³ /h	780/600		1020/720	
Electrical data	Power outlet	A	10		20	
	Running current *1	A	0.40		0.55	
	Power input Rated frequency	W	60		80	
	Auxiliary heater	A(kW)	—		—	
	Fan motor current *1	A	0.22		0.27	
Fan motor	Model		PK6V19-EF		PK6V32-EF	
	Winding resistance (at20°C)	Ω	WHT-BLK : 257 BLK-BLU : 20 BLU-YLW : 27 YLW-BRN : 14 BRN-RED : 51(at 26°C)		WHT-BLK : 166 BLK-BLU : 52 BLU-YLW : 19 YLW-BRN : 8 BRN-RED : 40(at 26°C)	
Dimensions W×H×D		mm	1100×270×700		1100×270×700	
Weight		kg	33.5		33.5	
Special remarks	Air direction		1		1	
	Sound level (High/Low)		35/30		39/31	
	Fan speed (High/Low)		770/630		840/640	
	Fan speed regulator		3		3	
	External static pressure	Pa	Std : 30 Max : 50		Std : 30 Max : 50	
	Thermistor TH1 (at 25°C)	kΩ	10		10	
	Thermistor TH2 (at 25°C)	kΩ	10		10	
	Thermistor TH5 (at 25°C)	kΩ	10		10	

NOTE : Test conditions are based on ISO 5151

Cooling : Indoor D.B. 27°C W.B. 19°C

Outdoor D.B. 35°C W.B. 24°C

Heating : Indoor D.B. 20°C W.B. 15°C

Outdoor D.B. 7°C W.B. 6°C

Refrigerant piping length (one way): 5m

*1 Measured under rated operating frequency.

Specifications and rating conditions of main electric parts

INDOOR UNIT

Item	Model	SEZ-KA35VA.TH	SEZ-KA50VA.TH	SEZ-KA60VA.TH	SEZ-KA71VA.TH
Indoor fan capacitor	(C1)	SEZ-KA35/50VA.TH : 2.5μF 440V SEZ-KA60VA.TH : 3.0μF 440V SEZ-KA71VA.TH : 4.0μF 440V			
Fuse	(FUSE)	250V 6.3A			
Varistor	(ZNR)	ERZV10D471			
Terminal block	(TB)	TO OUTDOOR UNIT : 3P TO WIRED REMOTE CONTROLLER : 2P			
Indoor fan motor thermal fuse		141°C ±3°C			



Indoor model			SEZ-KA60VA.TH		SEZ-KA71VA.TH	
Function			Cooling	Heating	Cooling	Heating
Power supply			Single phase 230V, 50Hz		Single phase 230V, 50Hz	
Capacity	Air flow (High/Low)	m³ /h	1200/720		1200/720	
Electrical data	Power outlet	A	20		20	
	Running current *1	A	0.65		0.60	
	Power input Rated frequency	W	100		130	
	Auxiliary heater	A(kW)	—		—	
	Fan motor current *1	A	0.39		0.51	
Fan motor	Model		PK6V50-EF		PK4V60-EA	
	Winding resistance	Ω	WHT-BLK : 103 BLK-BLU : 57 BLU-YLW : 15 YLW-BRN : 7 BRN-RED : 29 (at 26°C)		WHT-BLK : 108 BLK-BLU : 29 BLU-YLW : 26 YLW-BRN : 14 BRN-RED : 34 (at 26°C)	
Dimensions W×H×D		mm	1100×270×700		1100×270×700	
Weight		kg	33.5		35	
Special remarks	Air direction		1		1	
	Sound level(High/Low)	dB(A)	43/32		43/32	
	Fan speed(High/Low)	rpm	890/660		1050/690	
	Fan speed regulator		3		3	
	External static pressure	Pa	Std : 30 Max : 50		Std : 30 Max : 50	
	Thermistor TH1 (at 25°C)	kΩ	10		10	
	Thermistor TH2 (at 25°C)	kΩ	10		10	
	Thermistor TH5 (at 25°C)	kΩ	10		10	

NOTE : Test conditions are based on ISO 5151
Cooling : Indoor D.B. 27°C W.B. 19°C
Outdoor D.B. 35°C W.B. 24°C
Heating : Indoor D.B. 20°C W.B. 15°C
Outdoor D.B. 7°C W.B. 6°C
Refrigerant piping length (one way): 5m
*1 Measured under rated operating frequency.




NOISE CRITERION CURVES

SEZ-KA35VA.TH

<50Hz>


NOTCH	SPL(dB)	LINE
High	35	○—○
Low	30	●—●

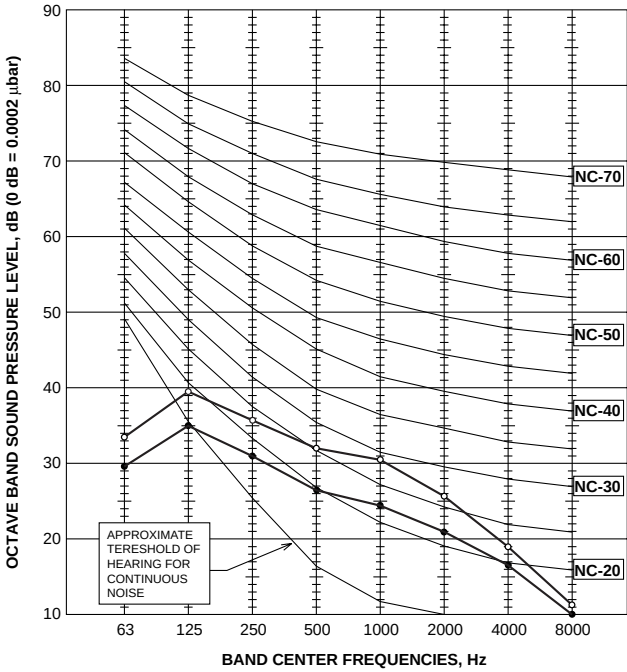

SEZ-KA50VA.TH

<50Hz>

NOTCH	SPL(dB)	LINE
High	39	○—○
Low	31	●—●


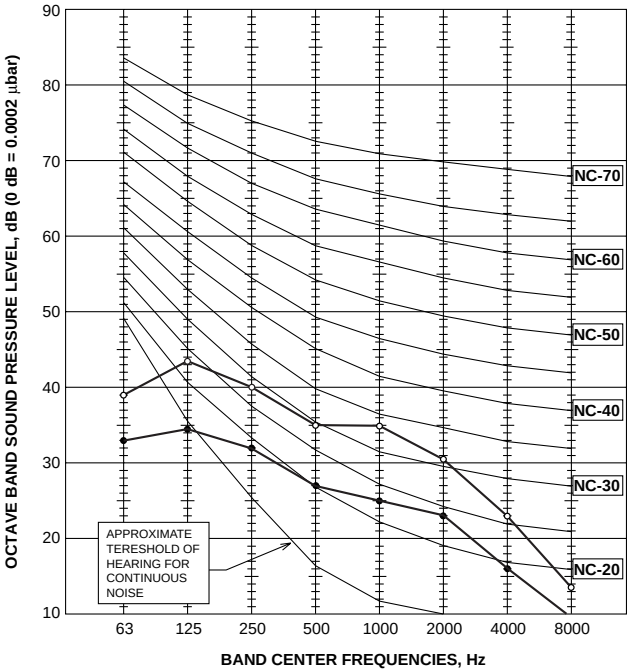


SEZ-KA60VA.TH

SEZ-KA71VA.TH

<50Hz>

NOTCH	SPL(dB)	LINE
High	43	○—○
Low	32	●—●

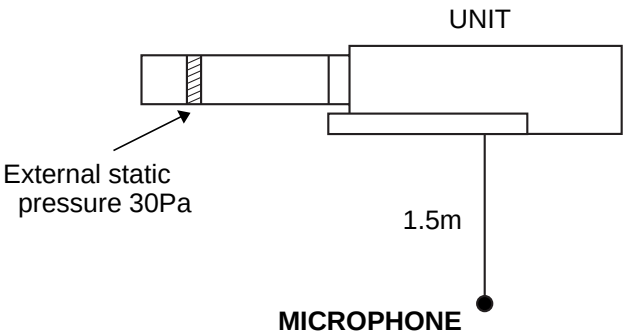
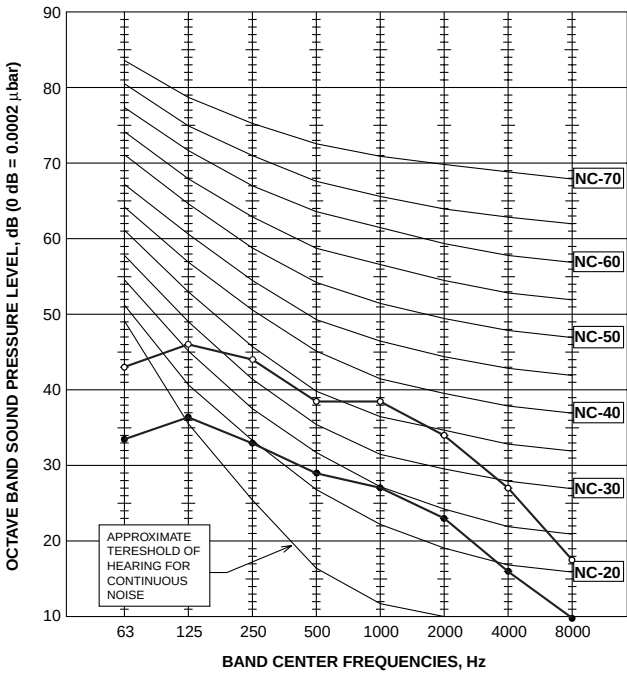


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than displayed level under actual installation condition by surrounding echoes. The sound level can be higher by about 2 dB than the displayed level during cooling and heating operation.





INDOOR FAN PERFORMANCE AND CORRECTED AIR FLOW

SEZ-KA35VA.TH

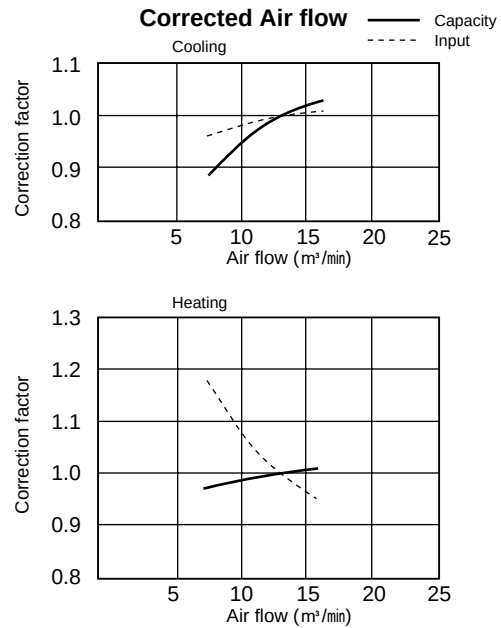
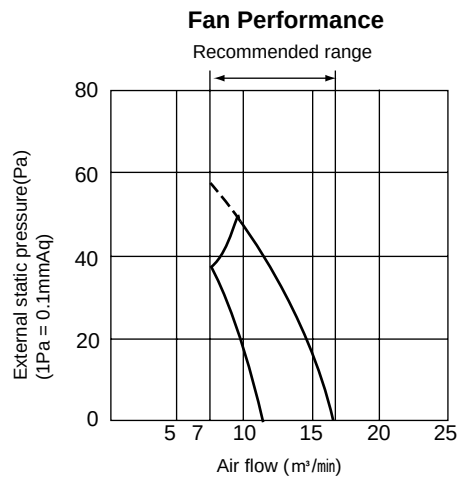


SEZ-KA50VA.TH

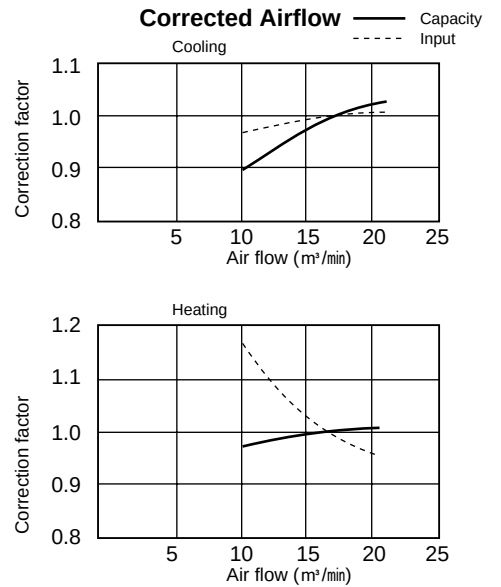
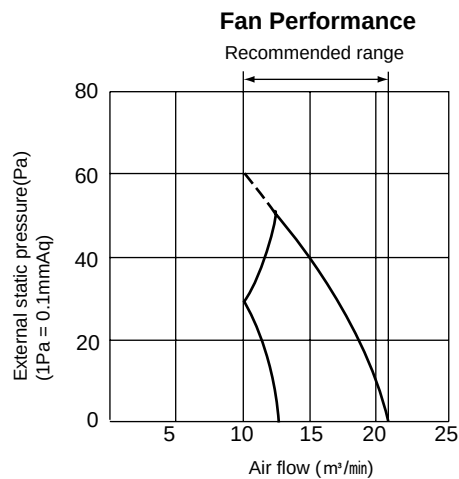


INDOOR FAN PERFORMANCE AND CORRECTED AIR FLOW

SEZ-KA60VA.TH

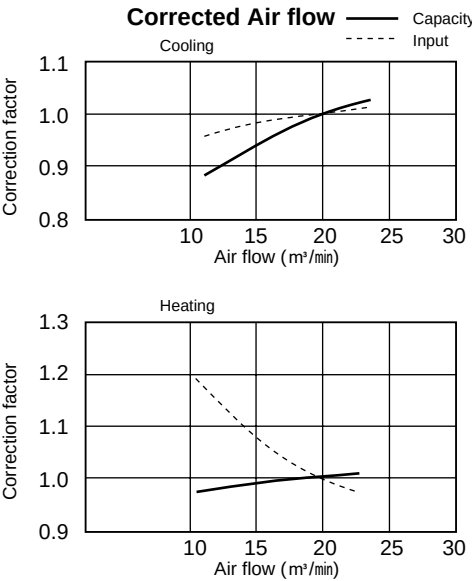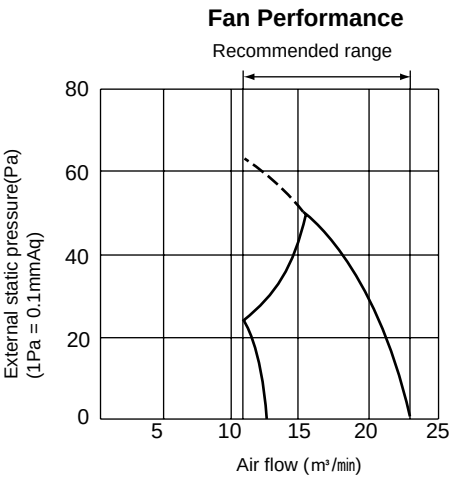

SEZ-KA71VA.TH

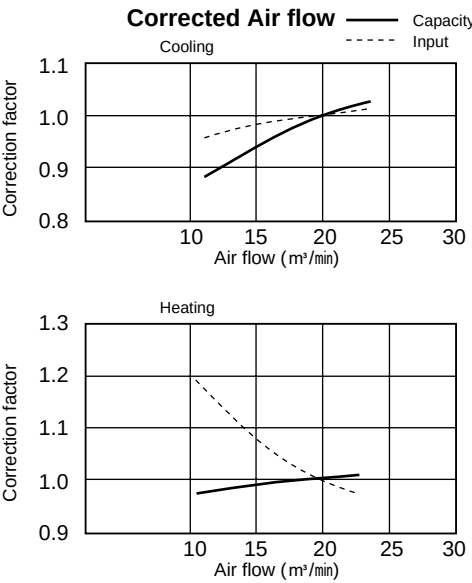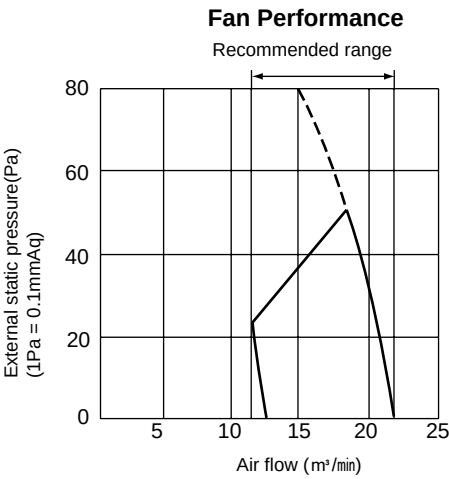


3

OUTLINES AND DIMENSIONS


SEZ-KA35VA.TH
SEZ-KA50VA.TH
SEZ-KA60VA.TH
SEZ-KA71VA.TH

Unit : mm

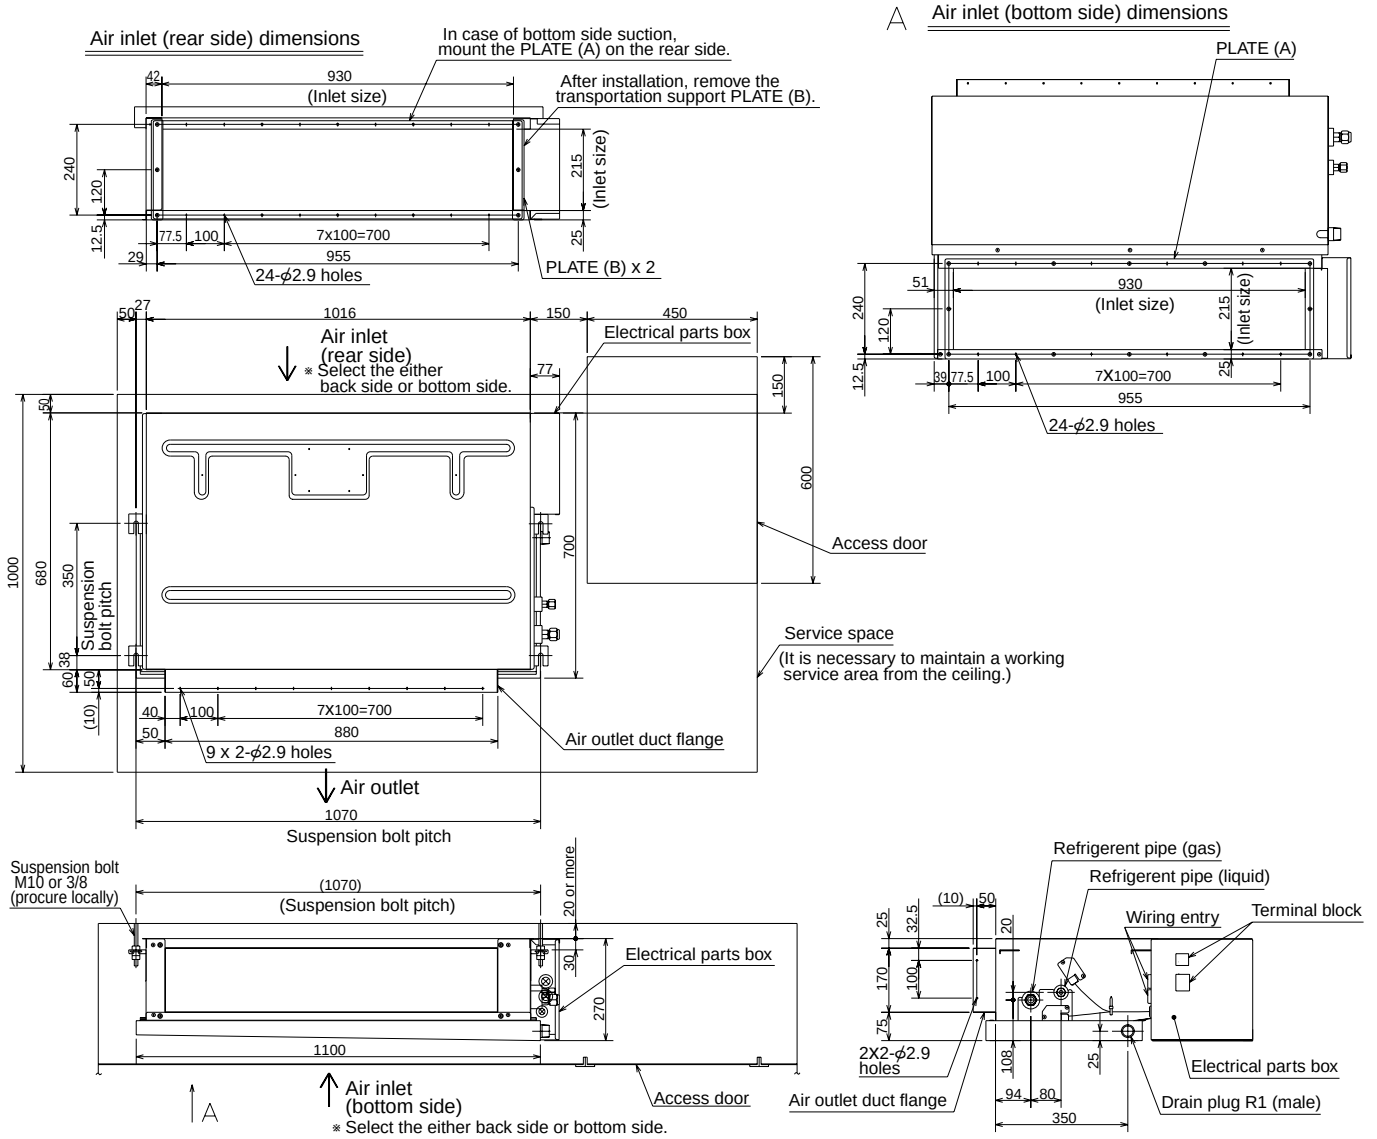

WIRING DIAGRAM

SEZ-KA35VA.TH
SEZ-KA50VA.TH
SEZ-KA60VA.TH
SEZ-KA71VA.TH

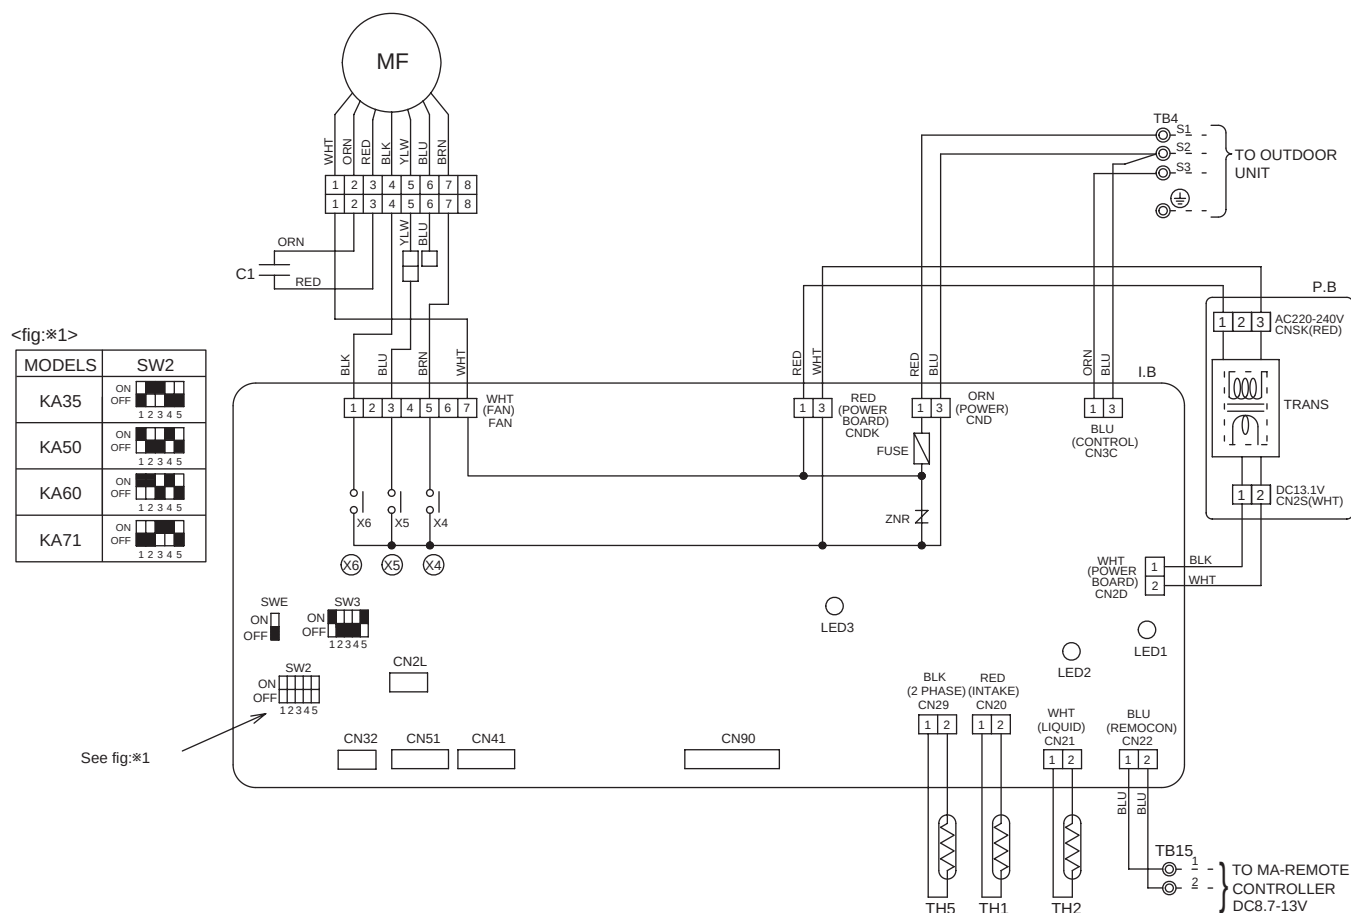


[LEGEND]

SYMBOL		NAME	SYMBOL	NAME
P.B		INDOOR POWER BOARD	C1	CAPACITOR(FAN MOTOR)
I.B		INDOOR CONTROLLER BOARD	MF	FAN MOTOR
	CN2L	CONNECTOR(LOSSNAY)	TB4	TERMINAL BLOCK(INDOOR/OUTDOOR CONNECTING LINE)
	CN32	CONNECTOR(REMOTE SWITCH)	TB15	TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE)
	CN41	CONNECTOR(HA TERMINAL-A)	TH1	ROOM TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT)
	CN51	CENTRALLY CONTROL	TH2	PIPE TEMP.THERMISTOR/LIQUID (0°C/15kΩ,25°C/5.4kΩ DETECT)
	CN90	CONNECTOR(WIRELESS)	TH5	COND./EVA.TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT)
	FUSE	FUSE(T6.3AL250V)		
	LED1	POWER SUPPLY(I.B)		
	LED2	POWER SUPPLY(I.B)		
	LED3	TRANSMISSION(INDOOR-OUTDOOR)		
	SW2	SWITCH(CAPACITY CODE)		
	SW3	SWITCH(MODE SELECTION)		
	SWE	SWITCH(EMERGENCY OPERATION)		
	X4	RELAY(FAN MOTOR LL)		
	X5	RELAY(FAN MOTOR Lg)		
	X6	RELAY(FAN MOTOR HI)		
	ZNR	VARISTOR		

NOTES: 1.Since the outdoor side electric wiring may change be sure to check the outdoor unit electric wiring for servicing.
2.Indoor and outdoor connecting wires are made with polarities,make wiring matching terminal numbers(S1,S2,S3).
3.Symbols used in wiring diagram above are,  :Connector,  :Terminal(block).
4.Since the indoor fan motor(MF) is connected with 50Hz power, if 60Hz power is used, change the wiring connection shown in fig.*2.

<fig:*2>




*For details on how to operate self-diagnosis, refer to the technical manuals etc.

SEZ-KA35VA.TH

SEZ-KA50VA.TH


SEZ-KA60VA.TH

SEZ-KA71VA.TH

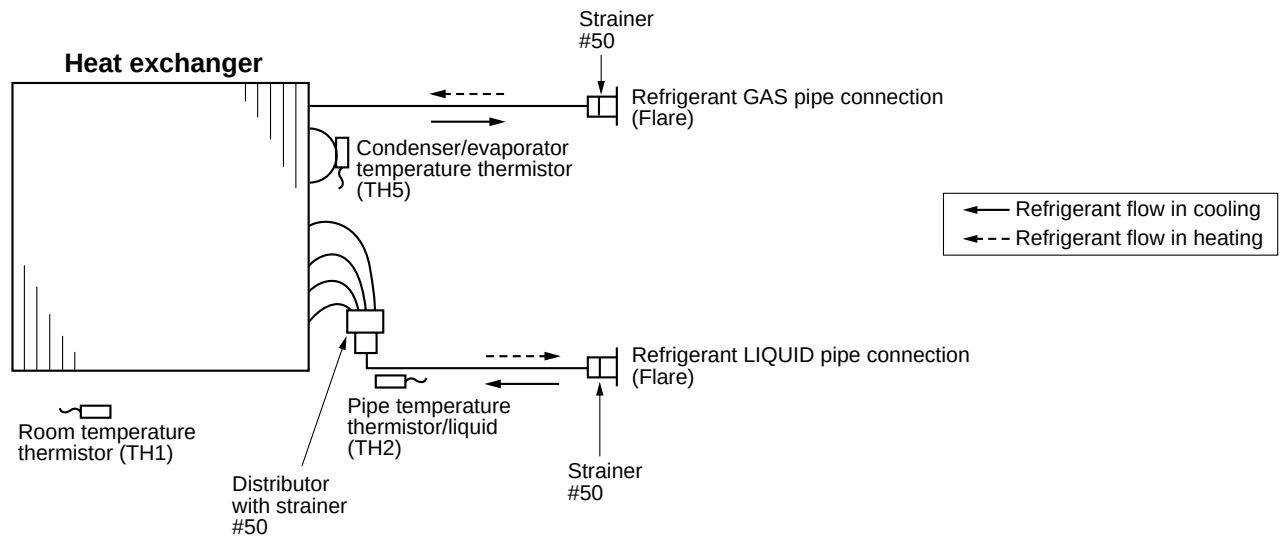

SEZ-KA71VA.TH

Connect to the indoor controller board (CN2D) between ① to ③ 12.6-13.7V DC (Pin① (+))




6-5-2. Indoor controller board

SEZ-KA35VA.TH

SEZ-KA50VA.TH

SEZ-KA60VA.TH

SEZ-KA71VA.TH

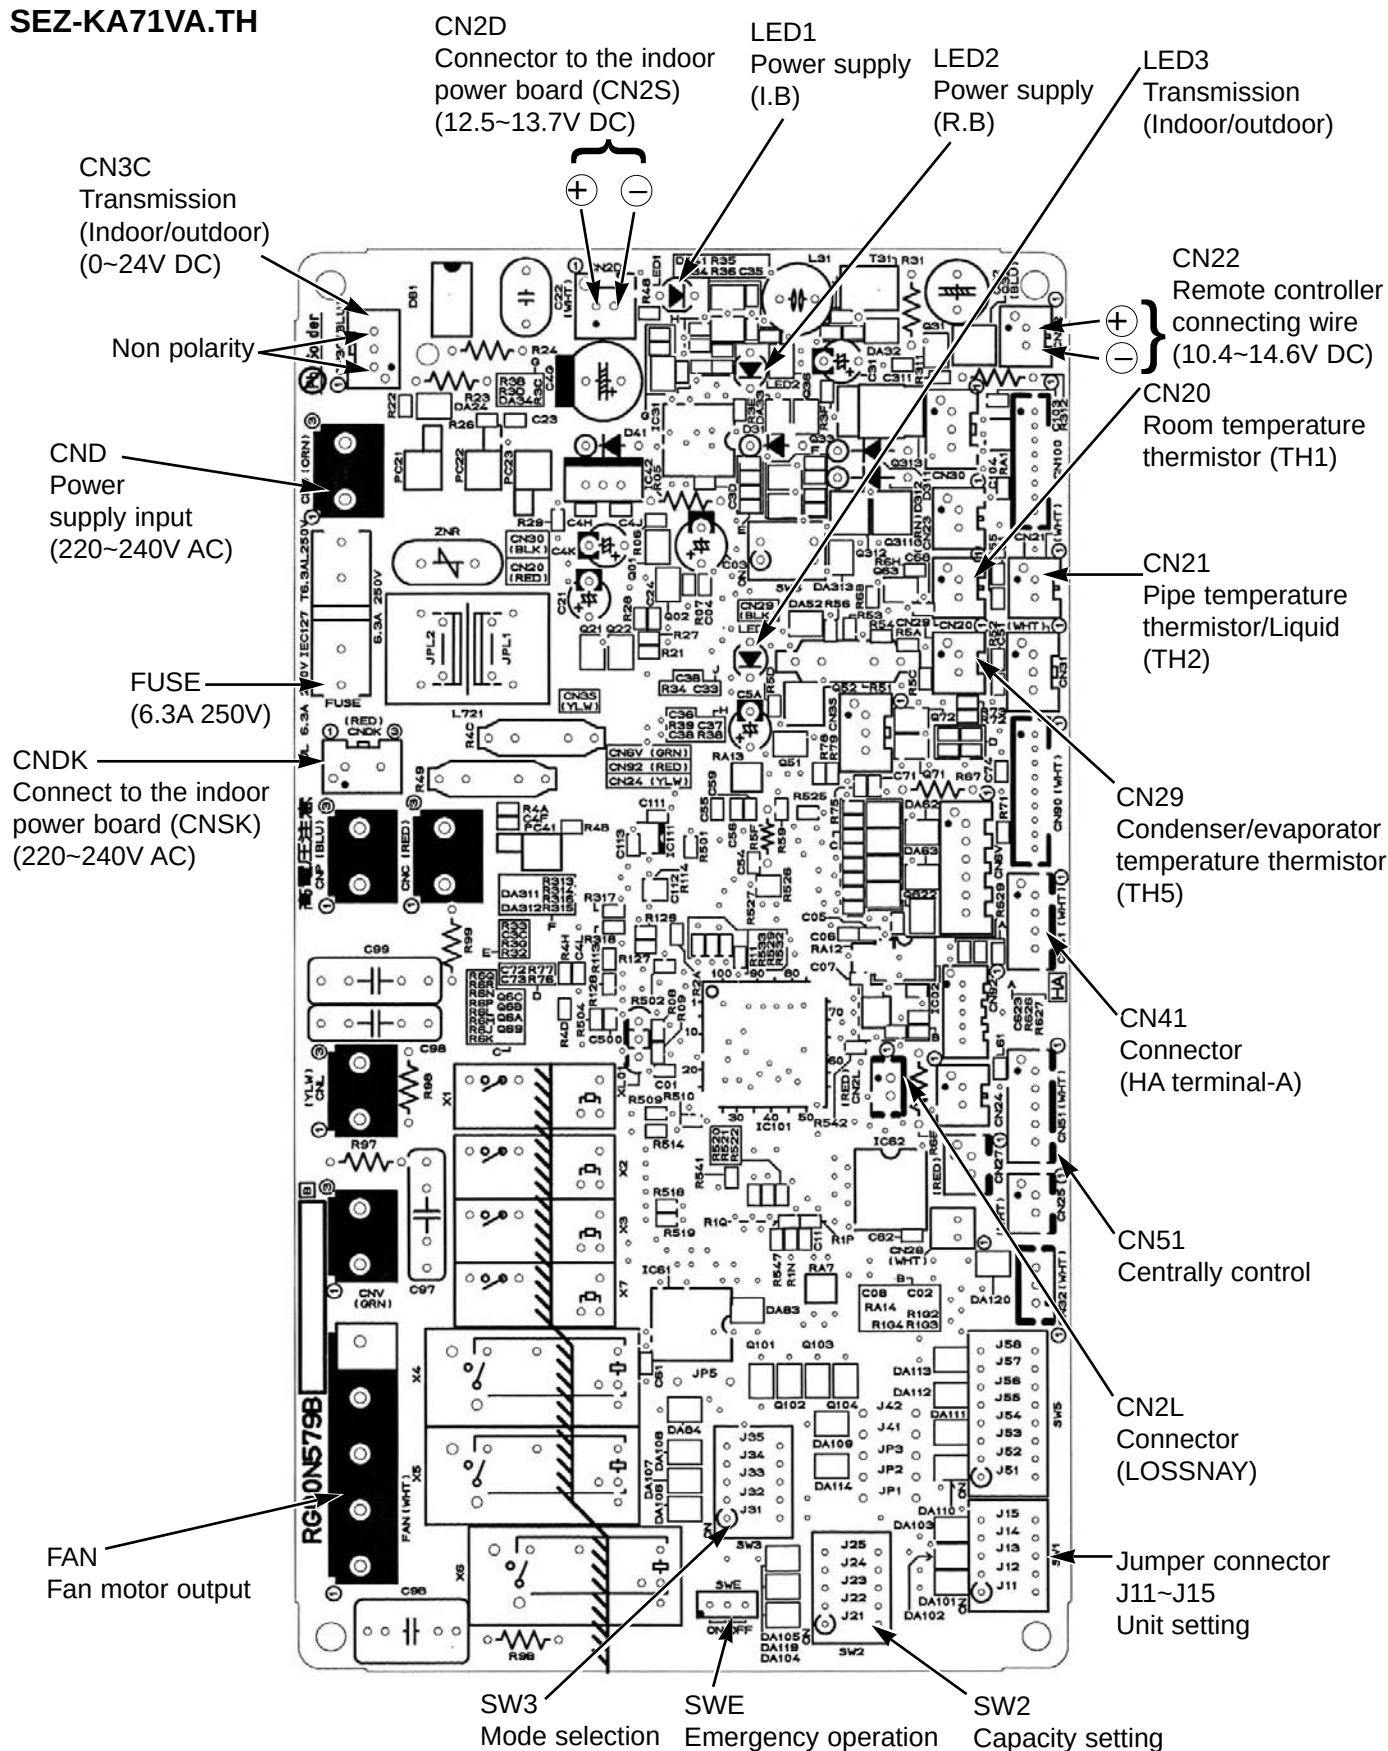

6-6. TROUBLE CRITERION OF MAIN PARTS

SEZ-KA35VA.TH


SEZ-KA50VA.TH

SEZ-KA60VA.TH

SEZ-KA71VA.TH

Part name	Check method and criterion																																								
Room temperature thermistor (TH1)	Measure the resistance with a tester. (Part temperature 10°C ~ 30°C) <table><tr><td>Normal</td><td colspan="4">Abnormal</td></tr><tr><td>8kΩ~20kΩ</td><td colspan="4">Opened or short-circuited</td></tr></table>					Normal	Abnormal				8kΩ~20kΩ	Opened or short-circuited																													
Normal						Abnormal																																			
8kΩ~20kΩ						Opened or short-circuited																																			
Pipe temperature thermistor/liquid (TH2)																																									
Condenser/evaporator temperature thermistor (TH5)																																									
Indoor fan motor (MF)	Measure the resistance between the terminals with a tester. (Coil wiring temperature 10°C ~ 30°C) <table><tr><td rowspan="2"></td><td colspan="4">Normal</td><td>Abnormal</td></tr><tr><td>KA35VA</td><td>KA50VA</td><td>KA60VA</td><td>KA71VA</td><td rowspan="6">Opened or short-circuited</td></tr><tr><td>WHT-BLK</td><td>270~244Ω</td><td>157~175Ω</td><td>97~109Ω</td><td>103~113Ω</td></tr><tr><td>BLK-BLU</td><td>19~21Ω</td><td>49~55Ω</td><td>54~60Ω</td><td>28~30Ω</td></tr><tr><td>BLU-YLW</td><td>25~29Ω</td><td>18~20Ω</td><td>14~16Ω</td><td>25~27Ω</td></tr><tr><td>YLW-BRN</td><td>13~15Ω</td><td>7~9Ω</td><td>6~8Ω</td><td>13~15Ω</td></tr><tr><td>BRN-RED</td><td>48~54Ω</td><td>38~42Ω</td><td>27~31Ω</td><td>32~36Ω</td></tr></table>						Normal				Abnormal	KA35VA	KA50VA	KA60VA	KA71VA	Opened or short-circuited	WHT-BLK	270~244Ω	157~175Ω	97~109Ω	103~113Ω	BLK-BLU	19~21Ω	49~55Ω	54~60Ω	28~30Ω	BLU-YLW	25~29Ω	18~20Ω	14~16Ω	25~27Ω	YLW-BRN	13~15Ω	7~9Ω	6~8Ω	13~15Ω	BRN-RED	48~54Ω	38~42Ω	27~31Ω	32~36Ω
	Normal				Abnormal																																				
	KA35VA	KA50VA	KA60VA	KA71VA	Opened or short-circuited																																				
WHT-BLK	270~244Ω	157~175Ω	97~109Ω	103~113Ω																																					
BLK-BLU	19~21Ω	49~55Ω	54~60Ω	28~30Ω																																					
BLU-YLW	25~29Ω	18~20Ω	14~16Ω	25~27Ω																																					
YLW-BRN	13~15Ω	7~9Ω	6~8Ω	13~15Ω																																					
BRN-RED	48~54Ω	38~42Ω	27~31Ω	32~36Ω																																					

Ⓟ : Thermal fuse
141 ± 3°C







Ⓟ : Thermal fuse
141 ± 3°C

SEZ-KA35VA.TH




SEZ-KA50VA.TH

SEZ-KA60VA.TH


SEZ-KA71VA.TH

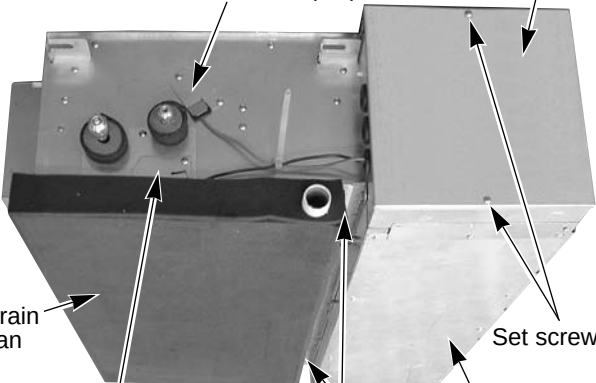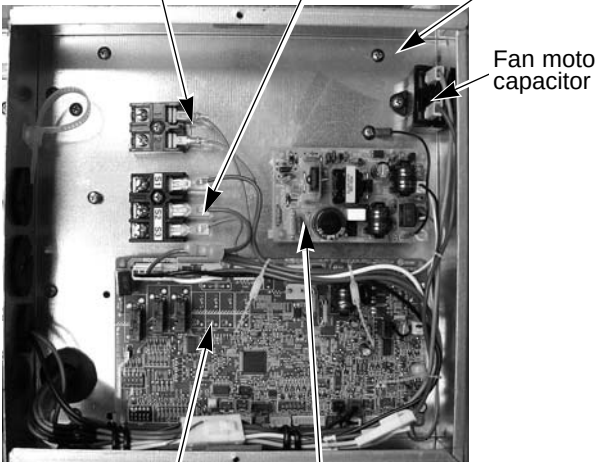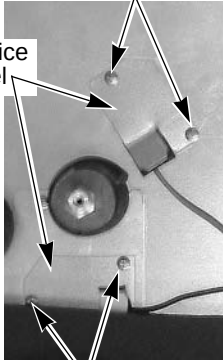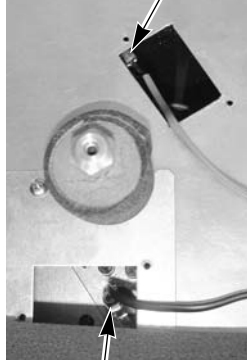OPERATING PROCEDURE	PHOTOS
1. Removing the electrical parts (1) Remove 2 screws of electrical cover and electrical parts cover. (See Photo 1) ● Indoor controller board (I.B) ● Terminal block (TB4,TB15) ● Indoor power board (P.B) ● Fan motor capacitor (C1) (See Photo 2)	Photo 1  Service panel (Pipe temperature thermistor / liquid) Electrical parts cover Drain pan Set screws Service panel (Condenser / evaporator temperature thermistor) Set screws (for drain pan) Front panel
2. Removing the pipe temperature thermistor (TH2) (1) Remove the electrical parts cover. (Refer to 1) (2) Remove 2 screws of service panel and service panel. (See Photo 3) (3) Remove the thermistor (TH2) from the holder. (See Photo 4) (4) Remove the connector (CN21) from the indoor controller board and pull the white wire of thermistor (TH2) out.	Photo 2  Terminal block (TB15) Terminal block (TB4) Indoor controller box Fan motor capacitor Indoor controller board Indoor power board
3. Removing the condenser / evaporator temperature thermistor (TH5) (1) Remove the electrical parts cover. (Refer to 1) (2) Remove the service panel. (See Photo 3) (3) Remove the thermistor (TH5) from the holder. (See Photo 4) (4) Remove the connector (CN29) from the indoor controller board and pull the black wire of thermistor (TH5) out.	Photo 3  Screws Service panel Screws Photo 4  Pipe temperature thermistor / liquid (TH2) Condenser / evaporator temperature thermistor (TH5)

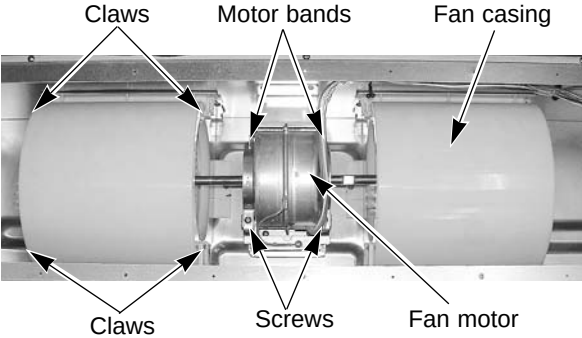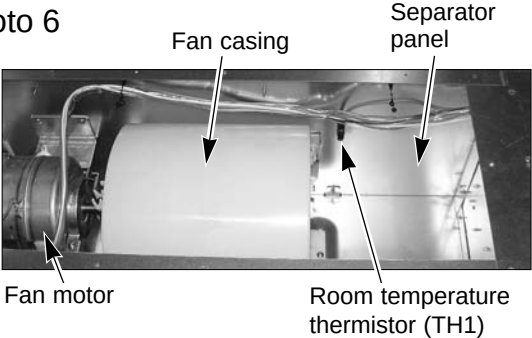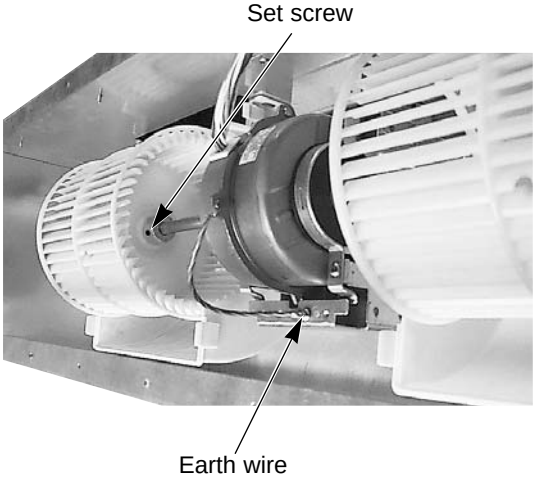

OPERATING PROCEDURE	PHOTOS
4. Removing the room temperature thermistor (TH1) (1) Remove the electrical parts cover. (Refer to 1) (2) Remove 12 screws of front panel and the front panel at fan side. (See Photo 1) (3) Remove the thermistor (TH1) from the separator panel. (See Photo 6) (4) Disconnect the connector (CN20) from the indoor controller board and pull the lead wire of thermistor (TH1) out.	Photo 5  Photo 6 
5. Removing the sirocco fan and the fan motor (MF). (1) Remove the electrical parts cover. (Refer to 1) (2) Remove 12 screws of front panel and the front panel at fan side. (See Photo 1) (3) Disconnect the connector of the fan motor lead wire. (See Photo 2) (4) Undo the 4 claws and remove the fan claws.(down side) <Either left or right> (See Photo 5) (5) Remove the motor bands. <A screw each on left and right.> (See Photo 5) (6) Disconnect the earth wire from the fan motor leg. (See Photo 7) (7) Remove the fan motor and the sirocco fan by assembly. (See Photo 7) (8) Unscrew set screw and remove the sirocco fan. <Either left or right> (See Photo 7)	Photo 7 

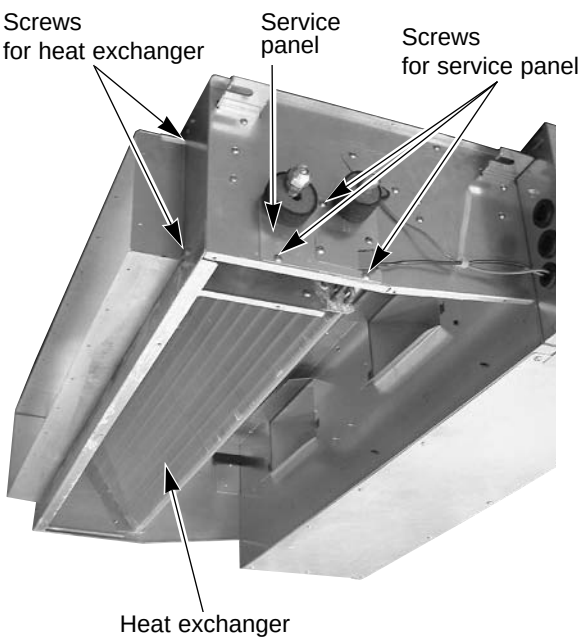

OPERATING PROCEDURE	PHOTOS
6. Removing the drain pan (1) Unscrew each set screw on the right and left, and remove the drain pan pushing it toward the the back. (See Photo 1)	Photo 8  Screws Under flange
7. Removing the heat exchanger (1) Remove the drain pan. (Refer to 6) (2) Remove the 16 screws and the Under flange at heat exchanger side. (See Photo 8) (3) Remove the 4 screws of heat exchanger.(2 screws each on left and right) (See Photo 9) (4) Remove the thermistor (TH2) from the holder. (Refer to 2) (5) Remove the thermistor (TH5) from the holder. (Refer to 3) (6) Remove the 3 screws and the service panel. (See Photo 9) (7) Put the heat exchanger down to the fan motor and pull it toward you. (See Photo 9)	Photo 9  Screws for heat exchanger Service panel Screws for service panel Heat exchanger

INDOOR UNIT


STRUCTURAL PARTS

SEZ-KA35VA.TH

SEZ-KA50VA.TH


SEZ-KA60VA.TH

SEZ-KA71VA.TH

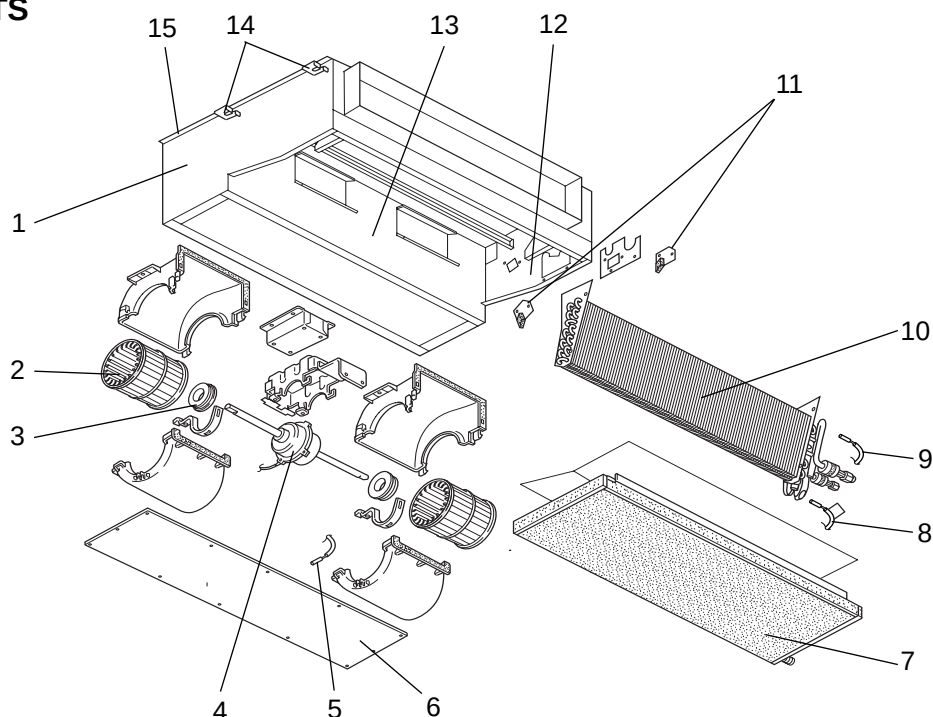

No.	Parts No.	Parts name	Specification	Q'ty/set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price	
				SEZ-KA · VA.TH							Unit	Amount
				35	50	60	71					
1	E07 039 086	LEFT SIDE PANEL		1	1	1	1					
2	E07 039 500	SIROCCO FAN		2	2	2	2					
3	E02 179 505	FAN MOTOR RUBBER MOUNT		2	2	2	2	<2PCS/SET>				
4	E07 039 300	FAN MOTOR	PK6V19-EF	1					MF			
	E07 040 300	FAN MOTOR	PK6V32-EF		1				MF			
	E07 041 300	FAN MOTOR	PK6V50-EF			1			MF			
	E07 223 300	FAN MOTOR	PK4V60-EA				1		MF			
5	E07 159 308	ROOM TEMPERATURE THERMISTOR		1	1	1	1		TH1			
6	E07 039 000	FRONT PANEL		1	1	1	1					
7	E07 039 700	DRAIN PAN		1	1	1	1					
8	E07 154 309	CONDENSER / EVAPORATOR TEMPERATURE THERMISTOR		1	1	1	1		TH5			
9	E07 159 307	PIPE TEMPERATURE THERMISTOR / LIQUID		1	1	1	1		TH2			
10	E07 143 620	INDOOR HEAT EXCHANGER		1								
	E07 144 620	INDOOR HEAT EXCHANGER			1							
	E07 145 620	INDOOR HEAT EXCHANGER				1						
	E07 223 620	INDOOR HEAT EXCHANGER					1					
11	E07 039 808	RIGHT LEG		2	2	2	2					
12	E07 143 085	RIGHT SIDE PANEL		1	1	1	1					
13	E07 143 293	SEPARATOR ASSY		1	1	1	1					
14	E07 039 809	LEFT LEG		2	2	2	2					
15	E07 039 290	BASE		1	1	1	1					

**INDOOR UNIT
ELECTRICAL PARTS
SEZ-KA35VA.TH
SEZ-KA50VA.TH
SEZ-KA60VA.TH
SEZ-KA71VA.TH**

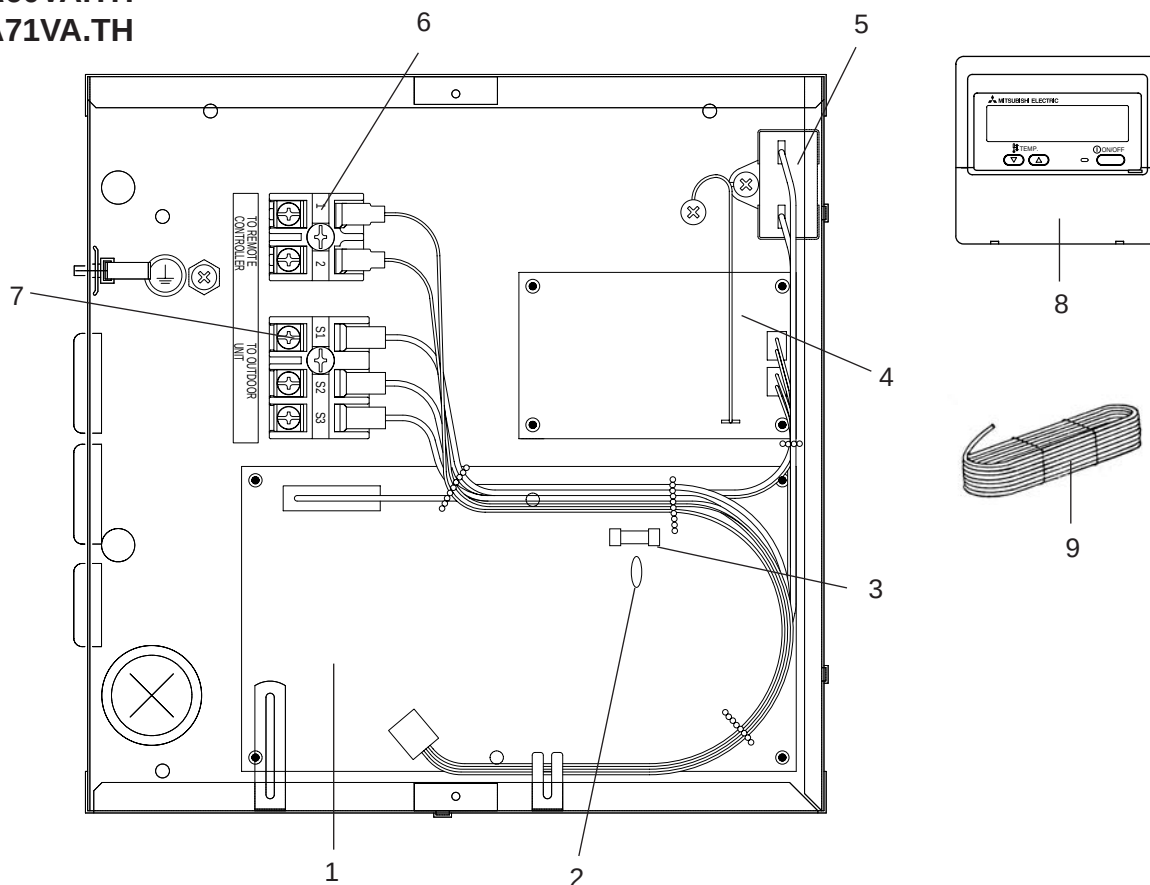

Part numbers that is circled is not shown in the figure.

No.	Parts No.	Parts name	Specification	Q'ty/set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price	
				SEZ-KA·VA.TH							Unit	Amount
				35	50	60	71					
1	E07 159 447	INDOOR CONTROLLER BOARD		1					I.B			
	E07 160 447	INDOOR CONTROLLER BOARD			1				I.B			
	E07 161 447	INDOOR CONTROLLER BOARD				1			I.B			
	E07 223 447	INDOOR CONTROLLER BOARD					1		I.B			
2	E02 661 385	VARISTOR		1	1	1	1		ZNR			
3	E07 006 382	FUSE	250V/6.3A	1	1	1	1		FUSE			
4	E07 154 440	INDOOR POWER BOARD		1	1	1	1		P.B			
5	E02 063 351	FAN MOTOR CAPACITOR	2.5μF/440VAC	1	1				C1			
	E02 138 351	FAN MOTOR CAPACITOR	3.0μF/440VAC			1			C1			
	E02 064 351	FAN MOTOR CAPACITOR	4.0μF/440VAC				1		C1			
6	E07 156 375	TERMINAL BLOCK	2P	1	1	1	1		TB15			
7	E07 162 375	TERMINAL BLOCK	3P	1	1	1	1		TB4			
8	E07 159 426	REMOTE CONTROLLER		1	1	1	1		R.B			
9	E07 018 089	REMOTE CONTROLLER CABLE		1	1	1	1					
⑩	E07 039 449	CONTROLLER COVER		1	1	1	1					

INDOOR UNIT


STRUCTURAL PARTS

SEZ-KA35VA.TH

SEZ-KA50VA.TH


SEZ-KA60VA.TH

SEZ-KA71VA.TH

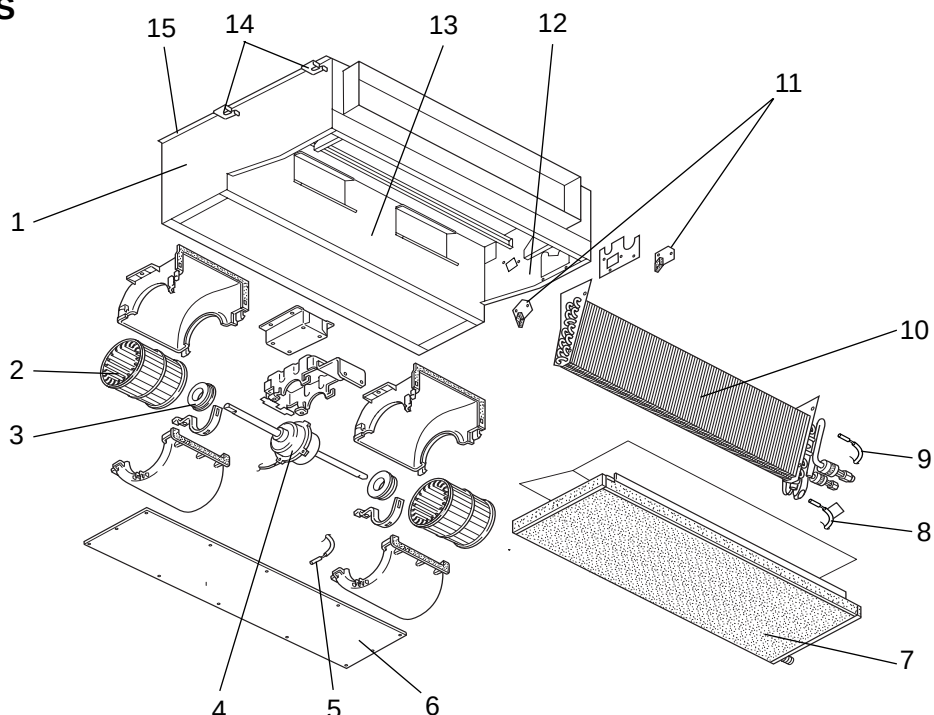

No.	RoHS	Parts No.	Parts name	Specification	Q'ty/set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price	
					SEZ-KA · VA.TH							Unit	Amount
					35	50	60	71					
1	G	E17 039 086	LEFT SIDE PANEL		1	1	1	1					
2	G	E17 039 500	SIROCCO FAN		2	2	2	2					
3	G	E12 179 505	FAN MOTOR RUBBER MOUNT		2	2	2	2	<2PCS/SET>				
4	G	E17 039 300	FAN MOTOR	PK6V19-EF	1					MF			
	G	E17 040 300	FAN MOTOR	PK6V32-EF		1				MF			
	G	E17 041 300	FAN MOTOR	PK6V50-EF			1			MF			
	G	E17 223 300	FAN MOTOR	PK4V60-EA				1		MF			
5	G	E17 159 308	ROOM TEMPERATURE THERMISTOR		1	1	1	1		TH1			
6	G	E17 039 000	FRONT PANEL		1	1	1	1					
7	G	E17 039 700	DRAIN PAN		1	1	1	1					
8	G	E17 154 309	CONDENSER / EVAPORATOR TEMPERATURE THERMISTOR		1	1	1	1		TH5			
9	G	E17 159 307	PIPE TEMPERATURE THERMISTOR / LIQUID		1	1	1	1		TH2			
10	G	E17 143 620	INDOOR HEAT EXCHANGER		1								
	G	E17 144 620	INDOOR HEAT EXCHANGER			1							
	G	E17 145 620	INDOOR HEAT EXCHANGER				1						
	G	E17 223 620	INDOOR HEAT EXCHANGER					1					
11	G	E17 039 808	RIGHT LEG		2	2	2	2					
12	G	E17 143 085	RIGHT SIDE PANEL		1	1	1	1					
13	G	E17 143 293	SEPARATOR ASSY		1	1	1	1					
14	G	E17 039 809	LEFT LEG		2	2	2	2					
15	G	E17 039 290	BASE		1	1	1	1					

**INDOOR UNIT
ELECTRICAL PARTS
SEZ-KA35VA.TH
SEZ-KA50VA.TH
SEZ-KA60VA.TH
SEZ-KA71VA.TH**

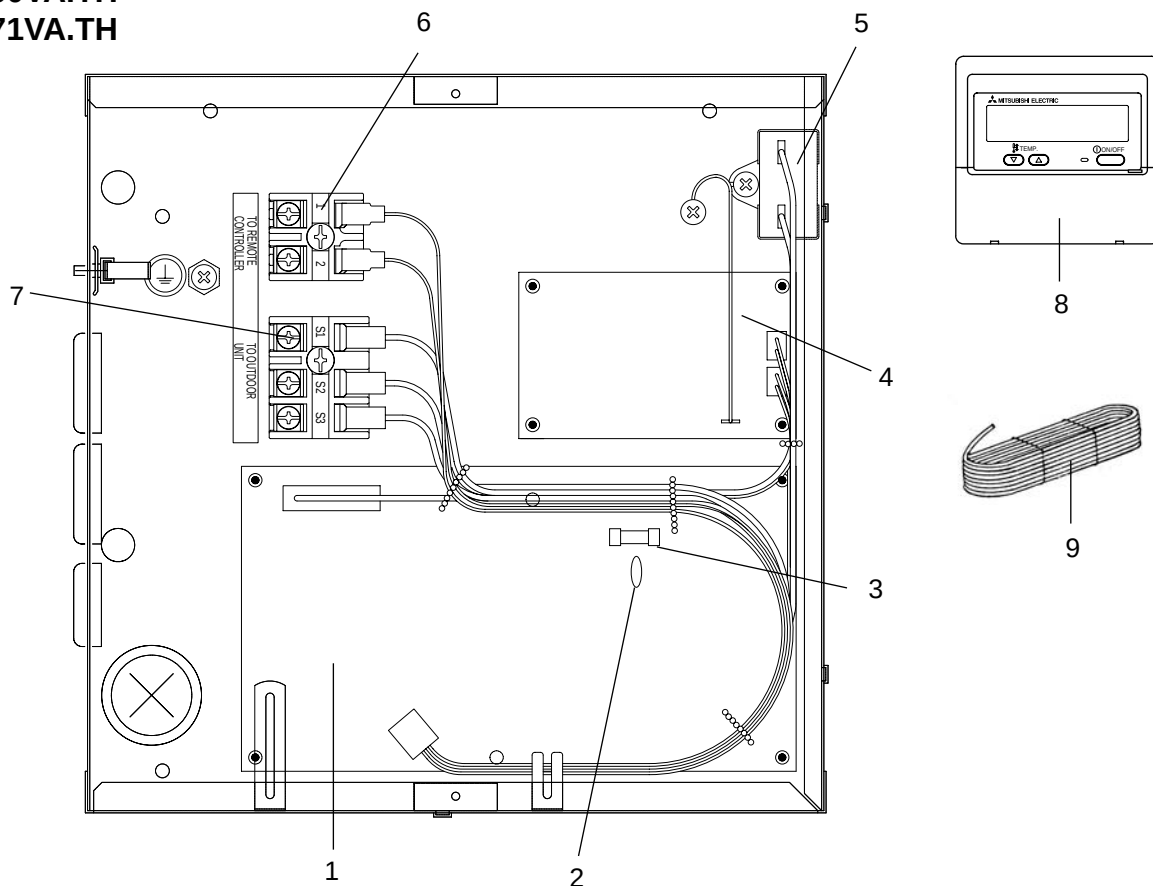

Part numbers that is circled is not shown in the figure.

No.	RoHS	Parts No.	Parts name	Specification	Q'ty/set				Remarks (Drawing No.)	Wiring Diagram Symbol	Recom- mended Q'ty	Price	
					SEZ-KA·VA.TH							Unit	Amount
					35	50	60	71					
1	G	E17 159 447	INDOOR CONTROLLER BOARD		1					I.B			
	G	E17 160 447	INDOOR CONTROLLER BOARD			1				I.B			
	G	E17 161 447	INDOOR CONTROLLER BOARD				1			I.B			
	G	E17 223 447	INDOOR CONTROLLER BOARD					1		I.B			
2	G	E12 661 385	VARISTOR		1	1	1	1		ZNR			
3	G	E17 006 382	FUSE	250V/6.3A	1	1	1	1		FUSE			
4	G	E17 154 440	INDOOR POWER BOARD		1	1	1	1		P.B			
5	G	E12 063 351	FAN MOTOR CAPACITOR	2.5μF/440VAC	1	1				C1			
	G	E12 138 351	FAN MOTOR CAPACITOR	3.0μF/440VAC			1			C1			
	G	E12 064 351	FAN MOTOR CAPACITOR	4.0μF/440VAC				1		C1			
6	G	E17 156 375	TERMINAL BLOCK	2P	1	1	1	1		TB15			
7	G	E17 162 375	TERMINAL BLOCK	3P	1	1	1	1		TB4			
8	G	E17 159 426	REMOTE CONTROLLER		1	1	1	1		R.B			
9	G	E17 018 089	REMOTE CONTROLLER CABLE		1	1	1	1					
⑩	G	E17 039 449	CONTROLLER COVER		1	1	1	1					

AIR FILTER

Applied unit	Models
SEZ-KA35VA.TH SEZ-KA50VA.TH SEZ-KA60VA.TH SEZ-KA71VA.TH	PAC - 1000 FT





Mr. SLIM™



HEAD OFFICE : TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN